



# Pool Permit Application

Address of Work: \_\_\_\_\_

Property Owner: \_\_\_\_\_

Phone \_\_\_\_\_

Address \_\_\_\_\_

City, State Zip \_\_\_\_\_

General Contractor \_\_\_\_\_

Phone \_\_\_\_\_

Address \_\_\_\_\_

City, State Zip \_\_\_\_\_

Electrician \_\_\_\_\_

Project Cost \_\_\_\_\_

Signature \_\_\_\_\_ Date \_\_\_\_\_

Information to be submitted when applying for permit:


1. A Survey of the property.
2. Pool location on the Lot.
3. Pool Dimensions  
Length \_\_\_\_\_ Width \_\_\_\_\_ Depth \_\_\_\_\_
4. Drawings or plans indicating type (gunite or vinyl) and construction (slopes) of the pool. (see insert example).
5. Details of the safety, gate (see insert example).
6. Details of the electrical installation.
7. Pool Class and/or Type
  - a. Commercial (A-D or N and VI-XI)
  - b. Residential (O or I-V).

## Pool Permit Sketch


Indicate the following information on the sketch:

1. Distance to the lot lines, street and house.
2. Location of overhead or below grade utilities.
3. Location of safety barrier.
4. Location of gate in safety barrier.
5. Location of the ladder and/or swim-out and hand rails.
6. Type and Location of Pump.
7. Type and Location of light fixtures, switches and receptacles within 20'
8. Location of pool deck if applicable (Note: A pool deck will require additional construction details including dimensions, type of lumber, guards and steps).
9. Location and type of pool drainage system. (where is it draining to)

See: City of Fairhope Electrical Code Supplement for bonding and electrical requirements for pools.

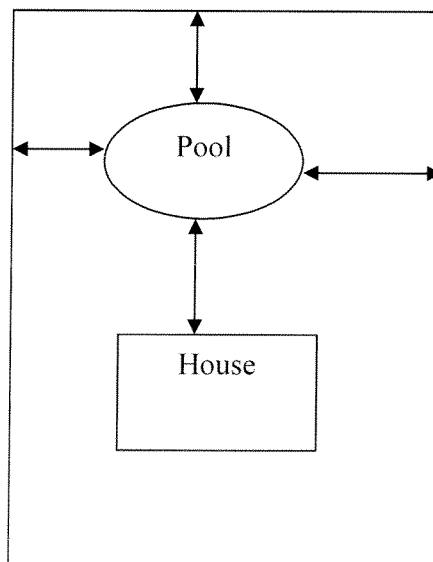

**FIGURE 5**  
**MINIMUM DIVING WATER ENVELOPE**




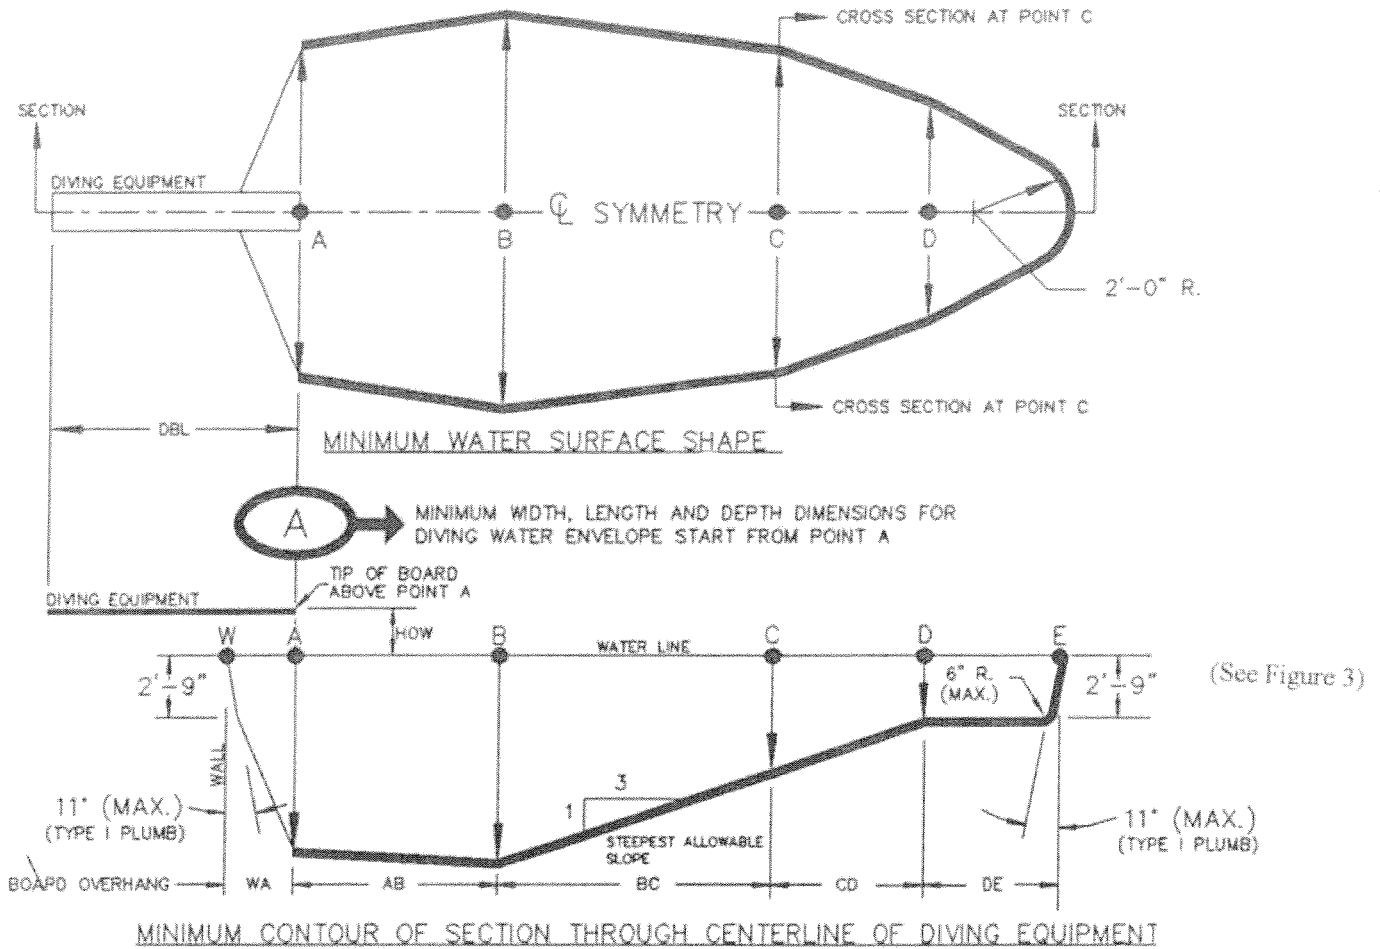


POOL TYPE	MAX. DIVING BOARD LENGTH	MAX. HEIGHT OVER WATER	MINIMUM DEPTHS AT POINT				MINIMUM WIDTHS AT POINT				MINIMUM LENGTHS BETWEEN POINTS			
	DBL <sup>**</sup>	HOW <sup>**</sup>	A	B	C	D	A	B	C	D	WA	AB	BC	CD <sup>*</sup>
DIVING EQUIPMENT														
I	6' DB/6' JB	20"	6'-0"	7'-6"	5'-0"	2'-9"	10'-0"	12'-0"	10'-0"	8'-0"	1'-6"	7'-0"	7'-6"	VARIABLES
II	8' DB/6' JB	20"	6'-0"	7'-6"	5'-0"	2'-9"	12'-0"	15'-0"	12'-0"	8'-0"	1'-6"	7'-0"	7'-6"	VARIABLES
III	10' DB/8' JB	26"	6'-10"	8'-0"	5'-0"	2'-9"	12'-0"	15'-0"	12'-0"	8'-0"	2'-0"	7'-6"	9'-0"	VARIABLES
IV	10' DB/8' JB	30"	7'-8"	8'-6"	5'-0"	2'-9"	15'-0"	18'-0"	15'-0"	9'-0"	2'-6"	8'-0"	10'-6"	VARIABLES
V	12' DB/8' JB	40"	8'-6"	9'-0"	5'-0"	2'-9"	15'-0"	18'-0"	15'-0"	9'-0"	3'-0"	9'-0"	12'-0"	VARIABLES

**NOTE:**

1. See Appendix J for Individual Pool Type Minimum Diving Water Envelopes.
- \* 2. Min. length between points CD may vary based upon water depth at point D and the slope between points C & D.
- \*\* 3. ABBREVIATIONS: DBL = Diving Board Length, DB = Diving Board, JB = Jump Board, HOW = Height Over Water
4. **IMPORTANT:** The walls of a Type I Pool, when defining the Maximum Diving Water Envelope shall be plumb.
5. Figure 5 drawings are not to scale.

**FIGURE 5 - Continued**  
**MINIMUM DIVING WATER ENVELOPE**

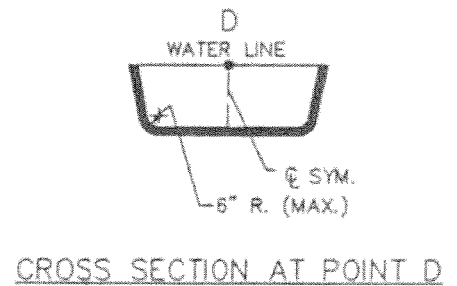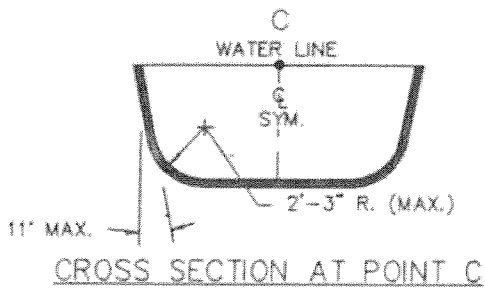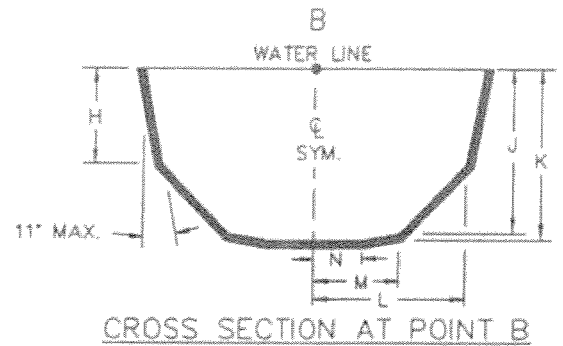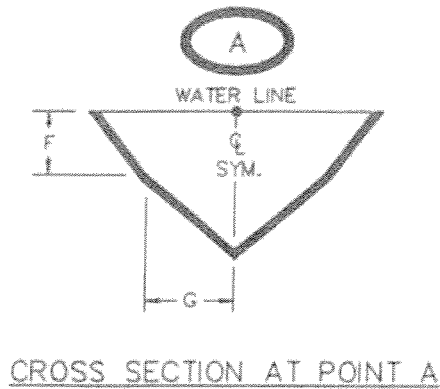


MINIMUM LENGTHS BETWEEN POINTS		CROSS SECTIONAL DIMENSIONS AT POINT A		CROSS SECTIONAL DIMENSIONS AT POINT B						POOL TYPE
DE	WE	F	G	H	J	K	L	M	N	
<b>IS PROHIBITED</b>										
6'-0"	28'-9"	2'-9"	5'-0"	4'-0"	7'-2 1/2"	7'-6"	6'-0"	3'-9"	2'-1 1/2"	I
6'-0"	28'-9"	2'-9"	3'-10"	4'-2"	7'-2 1/2"	7'-6"	6'-8"	3'-9"	2'-1 1/2"	II
6'-0"	31'-3"	2'-9"	4'-4 3/4"	4'-4 1/2"	7'-5 1/2"	8'-0"	6'-7"	3'-11 1/2"	1'-7 1/2"	III
6'-0"	33'-9"	2'-9"	5'-10 1/2"	3'-10"	7'-8"	8'-6"	8'-3"	5'-7"	2'-7"	IV
6'-0"	36'-9"	2'-9"	6'-2"	3'-11 1/2"	7'-9 1/2"	9'-0"	8'-2 1/2"	5'-9"	2'-1"	V


6. All dimensions are minimum, except where noted as maximum.
7. One half (1/2) the width shown at each point shall be available on each side of the diving equipment centerline.
8. Minimum water depth under tip of diving board (point A) is important to maintain.

FIGURE 7


EXAMPLES OF THE MINIMUM DIVING WATER ENVELOPE - TOP VIEW

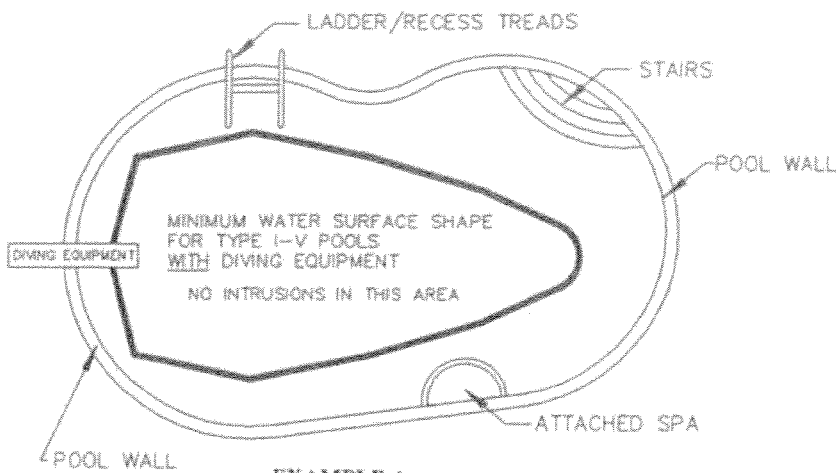

EXAMPLE A

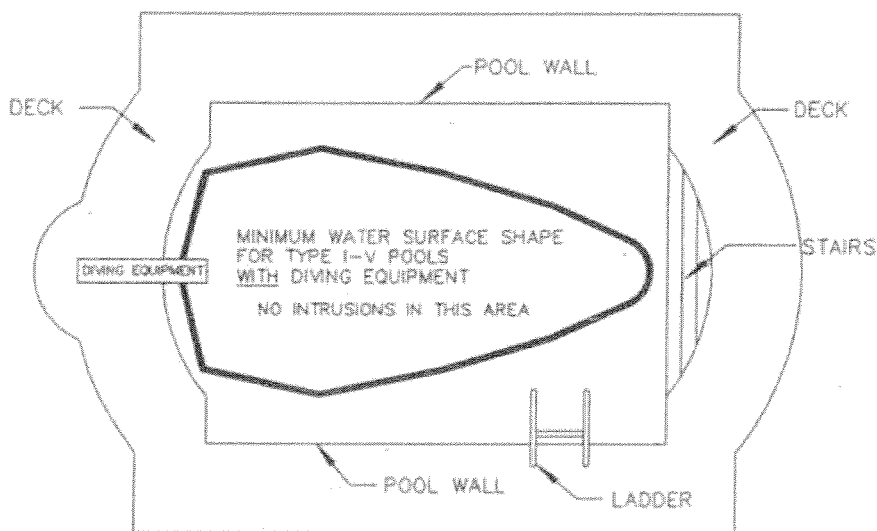

EXAMPLE B

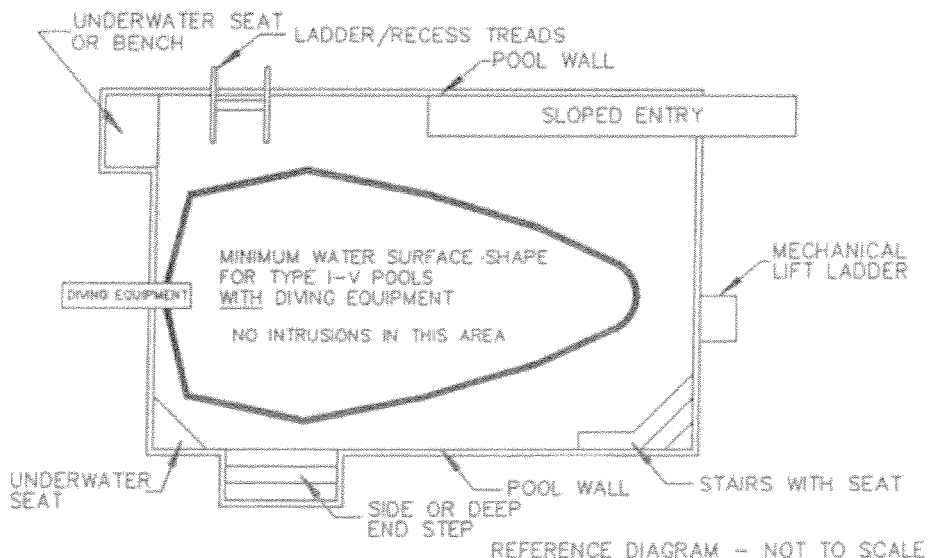

REFERENCE DIAGRAM - NOT TO SCALE

EXAMPLE C



## CITY CODE

### Swimming Pool Enclosure

7-8

7-10

#### FAIRHOPE CODE

#### **Sec.7-8. Swimming pool enclosures-Required.**

As used in sections 7-9 and 7-10, the term "family pool" means a swimming pool used or intended to be used solely by the owner, operator or lessee thereof and such person's family and by friends invited to use it without payment of any fee; and is considered a body of water in an artificial or semi-artificial receptacle or other container, whether located indoors or outdoors. (Ord. No. 575, § 1, 4-26-76)

#### **Sec.7-9. Same – Specifications; applicability.**

- (a) Every outdoor family swimming pool shall be completely surrounded by a fence or wall not less than four (4) feet in height, which shall be so constructed as not to have openings, holes or gaps larger than four (4) inches in any dimension except for doors and gates; and if a picket fence is erected or maintained, the horizontal dimension of gaps shall not exceed four (4) inches. A dwelling house or accessory building may be used as part of such enclosure.
- (b) All gates and doors opening through such enclosure shall be equipped with a self-closing and self-latching device for keeping the gate or door securely closed at all times when not in actual use, except that the door of any dwelling which forms a part of the enclosure need not be so equipped.
- (c) This requirement shall be applicable to all family pools, existing or hereafter constructed, other than indoor pools, and shall apply to all pools which have a maximum depth of eighteen (18) inches of water.
- (d) No person in possession of land within the city, either as owner, purchaser, lessee, tenant or licensee, upon which is situated a family swimming pool having a maximum depth of eighteen (18) or more inches shall fail to provide and maintain such fence or wall as herein provided. (Ord. No. 575, § 2, 4-26-76)

**Cross reference** – See also the swimming pool code, adopted in § 7-1

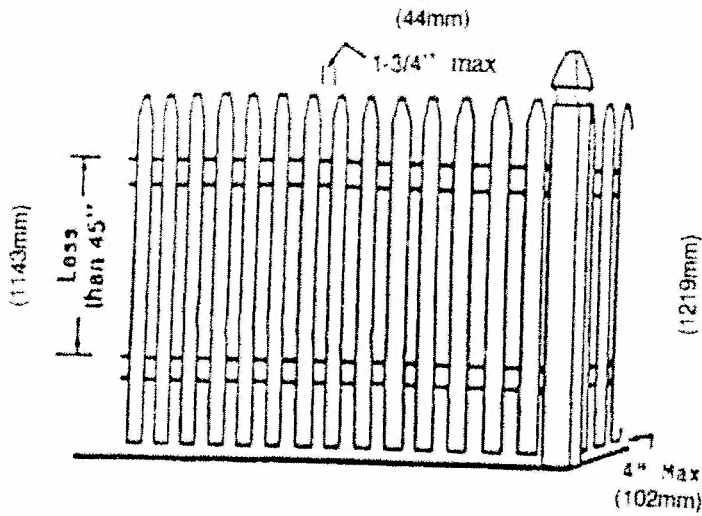


FIG. A IF HORIZONTAL MEMBERS ARE LESS THAN 45° APART, THE SPACE BETWEEN VERTICAL MEMBERS SHALL NOT EXCEED 1-3/4".

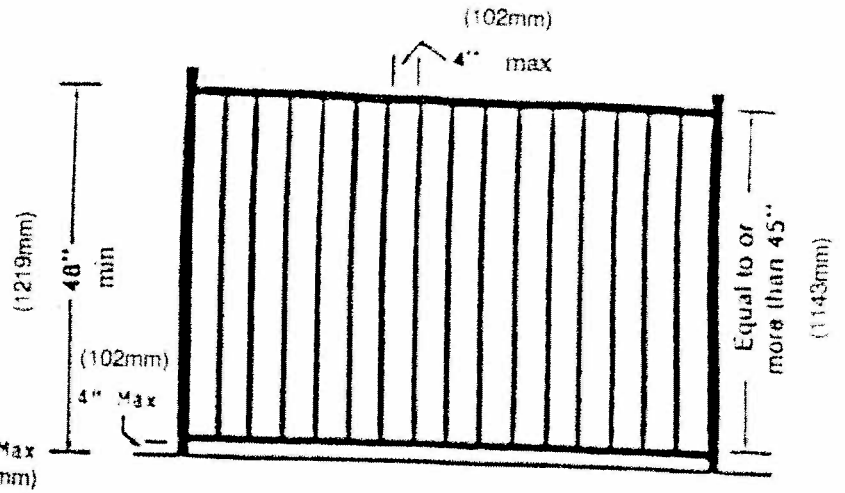


FIG. B IF HORIZONTAL MEMBERS ARE EQUAL TO OR MORE THAN 45° APART, THE SPACE BETWEEN VERTICAL MEMBERS SHALL NOT EXCEED 4".



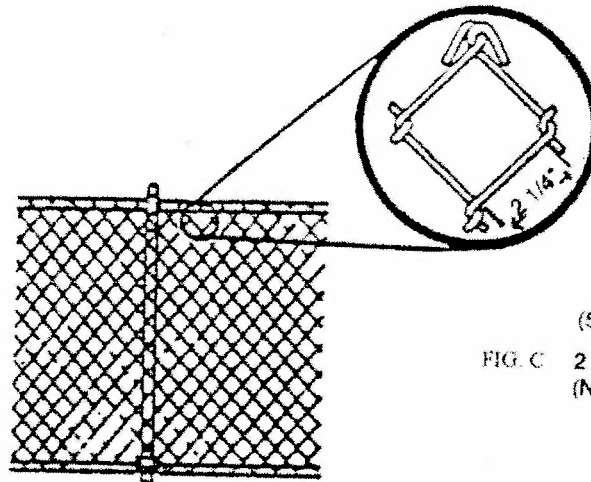


FIG. C 2 1/4" SQUARE CHAIN LINK MESH (NOMINAL)

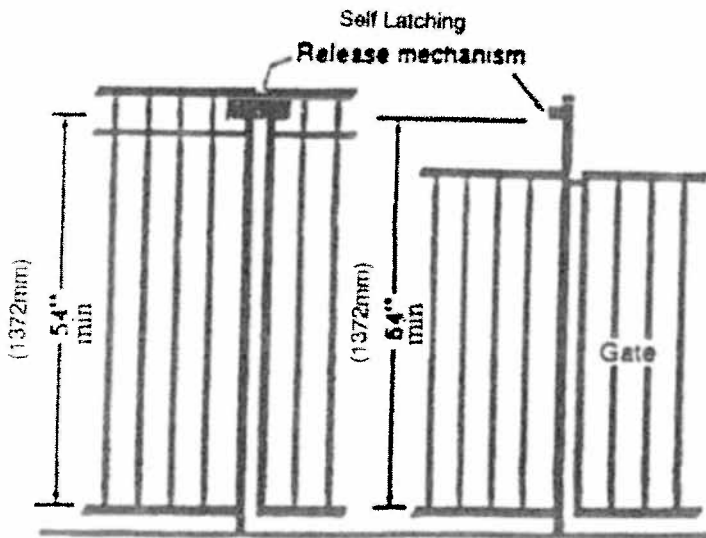

RELEASE MECHANISM LOCATED AT 54" OR HIGHER FROM THE BOTTOM OF THE GATE.

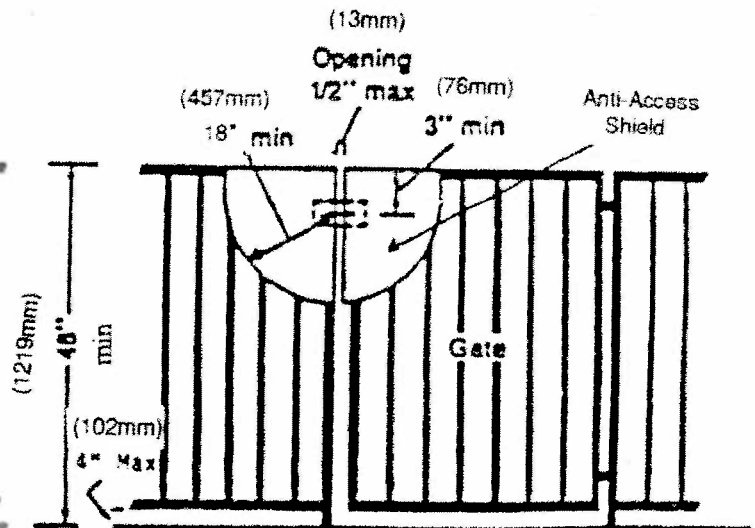

RELEASE MECHANISM LOCATED LESS THAN 54" FROM THE BOTTOM OF THE GATE.